


The model EJA115 Low Flow Transmitter is a flowmeter comprised of a differential pressure transmitter with an integral orifice and excellent for very low flow measurement. It outputs a 4 to 20 mA DC signal corresponding to the measured flow.

The orifice is available in six types with a bore ranging from 0.508 mm to 6.350 mm. The combination of the bore selection with the differential pressure measurement span variation of the differential pressure transmitter enables a wide range of very small flow measurement.

The model EJA115 also features remote setup and monitoring through communications with the model BT200/100 BRAIN TERMINAL, CENTUM CS/XL system etc.

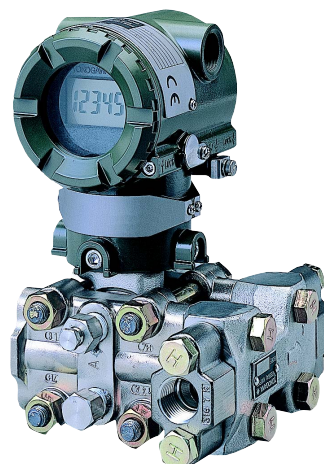

### STANDARD SPECIFICATIONS

Refer to GS 01C22T02-00E for Fieldbus communication type marked with “◇.”

#### Measurement Ranges:

Capsule	Differential Pressure Span	Water Equivalent Flow l/min	Air Equivalent Flow NI/min
L	1 to 10 kPa {100 to 1000 mmH <sub>2</sub> O}	0.016 to 7.2	0.44 to 198
M	2 to 100 kPa {200 to 10000 mmH <sub>2</sub> O}	0.022 to 23.0	0.63 to 635
H	20 to 210 kPa {2000 to 21000 mmH <sub>2</sub> O}	0.07 to 33.0	2.0 to 910

T01E.EPS

#### Output Signal “◇”:

4 to 20 mA DC, 2-wire system with digital communication

#### Failure Alarm:

Output status at CPU failure and hardware error;  
 Up-scale: 110%, 21.6 mA DC or more(standard)  
 Down-scale: -5%, 3.2 mA DC or less  
 -2.5%, 3.6 mA DC or less (Optional code /F1)  
 Note: Applicable for Output signal code D and E

#### Supply Voltage “◇”:

10.5 to 42 V DC for general use and flameproof type  
 10.5 to 32 V DC for lightning protector (Optional code /A)  
 10.5 to 30 V DC for intrinsically safe, Type n,  
 nonincendive, or non-sparking type  
 10.5 to 28 V DC for TIS intrinsically safe type

#### Conditions of Communication Line “◇”:

Power supply voltage; 16.4 to 42 V DC  
 Load resistance; See Figure 1.  
 Note: In case of an intrinsically safe transmitter, external load resistance includes safety barrier resistance.  
 Communication distance;  
 2 km, when CEV polyethylene-insulated PVC-sheathed control cables are used.  
 Note: Communication distance varies depends on kind of cable.

Load capacitance; 0.22 μF or less.  
 Load inductance; 3.3 mH or less.  
 Spacing from power line; 15 cm or more.  
 Input impedance of receiver connected receiving resistance;  
 10 kΩ or more at 2.4 kHz  
 (See Optional Specifications for Intrinsically safe type)

#### Accuracy:

±5 % of span

#### Ambient Temperature Limits:

-40 to 85 °C (-40 to 185 °F) (general-use type)  
 -30 to 80 °C (-22 to 176 °F) (with integral indicator)  
 (See ‘Optional Specifications’ for Explosion-protected types)

#### Process Temperature Limits:

-40 to 120 °C (-40 to 248 °F) (general use type)  
 (See ‘Optional Specifications’ for Explosion-protected types)

#### Ambient Humidity Limits:

5 to 100 % R.H.(at 40 °C)

#### Working Pressure Limits:

2.7 kPa abs{20 mmHg abs} to maximum working pressure  
 (See ‘Model and Suffix Codes’).  
 For atmospheric pressure or below, see Figure 2.

#### Power Supply Effect “◇”:

±0.005 %/V (21.6 to 32 V DC, 350 Ω)

#### Mounting:

2-inch pipe mounting.

#### Mounting Position Effect:

390 Pa {40 mmH<sub>2</sub>O}/90 °.  
 No effect for displacement parallel to diaphragm.  
 These errors can be corrected by the zero adjustment.

#### Degrees of Protection:

IP67, NEMA4X, JIS C0920 immersion proof

#### Explosion-protected Construction:

See ‘Optional Specification.’

**Electrical Connection:**

See 'Model and Suffix Codes.'

**Process Connections:**

See 'Model and Suffix Codes.'

**Wetted Parts Material:**

Diaphragm, cover flange, process connector, vent plug, manifold and orifice;

See 'Model and Suffix Codes.'

Capsule gaskets; Teflon-coated JIS SUS316L.

Process connector gasket; PTFE (Teflon)

**Flange Bolts and Nuts Material:**

See 'Model and Suffix Codes.'

**Amplifier Housing:**

Cast aluminum alloy or JIS SCS14A stainless steel (optional)

**Painting:**

Polyurethane resin backed finish

Deep sea moss green (Munsell 0.6GY3.1/2.0)

**Integral Indicator:**

LCD digital indicator (optional)

**Damping Time Constant:**

(Sum of time constants for amplifier assembly and capsule assembly)

Amplifier assembly time constant;

Can be set in 9 increments from 0.2 to 64 sec.

Capsule assembly time constant;

Capsule	L	M	H
Time Constant (sec)	Approx. 0.4	Approx. 0.3	Approx. 0.3

T02E.EPS

**External Zero Adjustment “◇”:**

Continuously Adjustable Resolution; 0.01 % of span

**Zero Adjustment Limits:**

Zero can be fully elevated or suppressed as long as low and high range values are within the measurement range limits of the capsule.

**Tag Plate:**

JIS SUS304.

**Weight:**

5.6 kg (12.4 lb) without integral indicator and mounting bracket.

Add 1.4 kg (3.1 lb) for JIS SCS14A stainless steel amplifier housing.

**EMC Conformity Standards:** CE , N200

EN61326, AS/NZS CISPR11

**European Pressure Equipment Directive 97/23/EC:**

Sound Engineering Practice

< Settings When Shipped > “◇”

Tag Number	As specified in order *1
Output Mode	'Linear' unless otherwise specified in order
Display Mode	'Square root'
Operation Mode	'Normal' unless otherwise specified in order
Damping Time Constant *2	'2 sec.'

Calibration Range Lower Range Value	As specified in order
Calibration Range Higher Range Value	As specified in order
Calibration Range Units	Selected from mmH <sub>2</sub> O, mmAq, mmWG, mmHg, Pa, hPa, kPa, MPa, mbar, bar, gf/cm <sup>2</sup> , kgf/cm <sup>2</sup> , inH <sub>2</sub> O, inHg, ftH <sub>2</sub> O, or psi. (Only one unit can be specified)

T05E.EPS

\*1: Up to 16 alphanumeric characters (including - and .) will be entered in the amplifier memory.

\*2: If using square root output, set damping time constant to 2 sec. or more.

<Measurement Range (Approximate Value)>

	Orifice Bore (mm)	L Capsule	M Capsule	H Capsule
Water Equivalent Maximum Flow Range l/min	0.508	0.016 to 0.049	0.022 to 0.157	0.07 to 0.225
	0.864	0.046 to 0.145	0.066 to 0.46	0.21 to 0.67
	1.511	0.134 to 0.42	0.19 to 1.35	0.60 to 1.93
	2.527	0.36 to 1.15	0.52 to 3.6	1.65 to 5.2
	4.039	0.92 to 2.9	1.3 to 9.2	4.1 to 13.0
Air Equivalent Maximum Flow Range NI/min	6.350	2.3 to 7.2	3.3 to 23	10 to 33
	0.508	0.44 to 1.40	0.63 to 4.4	1.98 to 6.4
	0.864	1.30 to 4.10	1.85 to 12.9	5.8 to 18.5
	1.511	3.7 to 11.7	5.3 to 37	16.7 to 54
	2.527	10.3 to 32	14.6 to 105	47 to 150
4.039	25 to 79	36 to 255	113 to 370	
	6.350	63 to 198	89 to 630	280 to 910

T06E.EPS

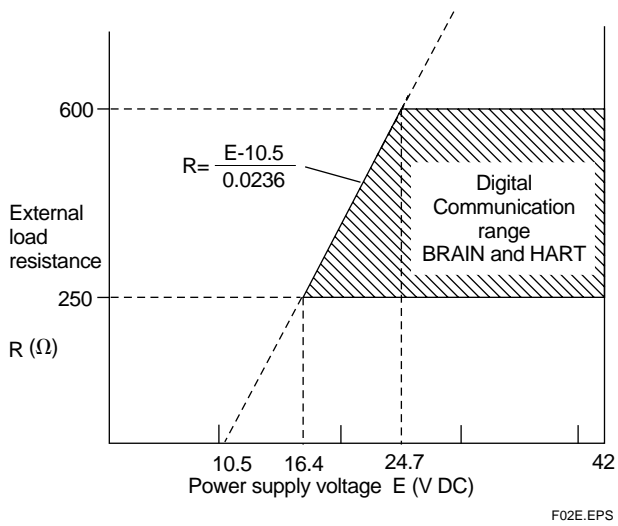


Figure 1. Relationship Between Power Supply Voltage and External Load Resistance

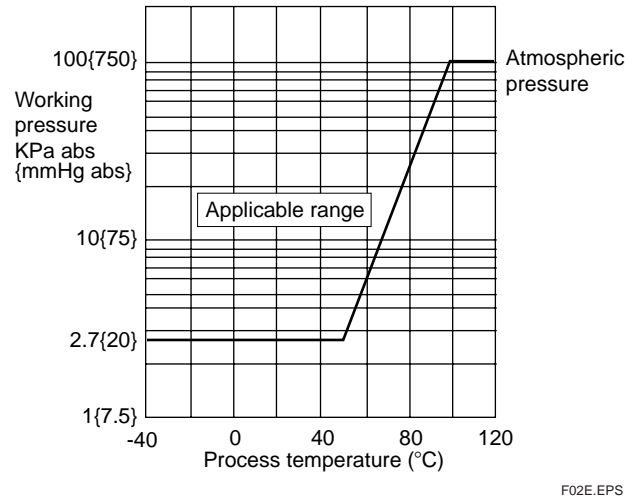



Figure 2. Working Pressure and Process Temperature

**MODEL AND SUFFIX CODES**

Model	Suffix Codes	Description
<b>EJA115</b>	.....	Low Flow transmitter
Output Signal	<b>-D</b> .....	4 to 20 mA DC with digital communication (BRAIN protocol)
	<b>-E</b> .....	4 to 20 mA DC with digital communication (HART protocol) *1
	<b>-F</b> .....	Digital communication (FOUNDATION Fieldbus protocol) *6
Measurement span (capsule)	<b>L</b> .....	1 to 10 kPa {100 to 1000 mmH <sub>2</sub> O}{4 to 40 inH <sub>2</sub> O}{10 to 100 mbar}
	<b>M</b> .....	2 to 100 kPa {200 to 10000 mmH <sub>2</sub> O}{8 to 400 inH <sub>2</sub> O}{20 to 1000 mbar}
	<b>H</b> .....	20 to 210 kPa {2000 to 21000 mmH <sub>2</sub> O}{80 to 830 inH <sub>2</sub> O}{200 to 2100 mbar}
Wetted parts material*8	<b>S</b> .....	[Body] [Capsule] [Orifice]
		JIS SCS14A*3 JIS SUS316L*2 JIS SUS316
Process flange rating ☆	<b>2</b> .....	Rc1/2 female
	<b>4</b> .....	1/2 NPT female
	<b>00</b> .....	Always 00
Bolts and nuts material	<b>A</b> .....	[Maximum working pressure]
		(L capsule) (M, H capsule)
		JIS SCM435 3.5 MPa {35 kgf/cm <sup>2</sup> } 14 MPa {140 kgf/cm <sup>2</sup> }
	<b>B</b> .....	JIS SUS630 3.5 MPa {35 kgf/cm <sup>2</sup> } 14 MPa {140 kgf/cm <sup>2</sup> }
Installation ☆	<b>-2</b> .....	Vertical impulse piping type, right side high pressure, manifold upside *4
	<b>-3</b> .....	Vertical impulse piping type, right side high pressure, manifold downside *4
	<b>-6</b> .....	Vertical impulse piping type, left side high pressure, manifold upside *4
	<b>-7</b> .....	Vertical impulse piping type, left side high pressure, manifold downside *4
	<b>-8</b> .....	Horizontal impulse piping type, right side high pressure *5
	<b>-9</b> .....	Horizontal impulse piping type, left side high pressure *5
Electrical connection ☆	<b>0</b> .....	G1/2 female, one electrical connection
	<b>2</b> .....	1/2 NPT female, two electrical connections without blind plug
	<b>3</b> .....	Pg 13.5 female, two electrical connections without blind plug
	<b>4</b> .....	M20 female, two electrical connections without blind plug
	<b>5</b> .....	G1/2 female, two electrical connections and a blind plug
	<b>7</b> .....	1/2 NPT female, two electrical connections and a blind plug
	<b>8</b> .....	Pg 13.5 female, two electrical connections and a blind plug
<b>9</b> .....	M20 female, two electrical connections and a blind plug	
Integral indicator ☆	<b>D</b> .....	Digital indicator
	<b>E</b> .....	Digital indicator with the range setting switch *7
	<b>N</b> .....	(None)
Mounting bracket ☆	<b>A</b> .....	JIS SECC 2-inch pipe mounting (flat type)
	<b>B</b> .....	JIS SUS304 2-inch pipe mounting (flat type)
	<b>C</b> .....	JIS SECC 2-inch pipe mounting (L type)
	<b>D</b> .....	JIS SUS304 2-inch pipe mounting (L type)
	<b>N</b> .....	(None)
Optional codes		/□ Optional specification

T07E.EPS

The '☆' marks indicate the most typical selection for each specification. Example: EJA115-DMS400A-92NA/□

- \*1: Refer to GS 01C22T01-00E for HART Protocol version.
- \*2: Diaphragm material is Hastelloy C-276 or ASTM N10276. Indicated is other capsule wetted parts materials.
- \*3: Indicates material of cover flange and process connector. Material of manifold and vent plug is JIS SUS316.
- \*4: If necessary, specify Mounting bracket code C or D.
- \*5: If necessary, specify Mounting bracket code A or B.
- \*6: Refer to GS 01C22T02-00E for Fieldbus communication.
- \*7: Not applicable for Output signal code F.
- \*8:  Users must consider the characteristics of selected wetted parts material and the influence of process fluids. The use of inappropriate materials can result in the leakage of corrosive process fluids and cause injury to personnel and/or damage to plant facilities. It is also possible that the diaphragm itself can be damaged and that material from the broken diaphragm and the fill fluid can contaminate the user's process fluids. Be very careful with highly corrosive process fluids such as hydrochloric acid, sulfuric acid, hydrogen sulfide, sodium hypochlorite, and high-temperature steam (150°C [302°F] or above). Contact Yokogawa for detailed information of the wetted parts material.

**OPTIONAL SPECIFICATIONS (For Explosion Protected types “◇”)**

For FOUNDATION Fieldbus explosion protected type, see GS 01C22T02-00E.

Item	Description	Code
Factory Mutual (FM)	FM Explosionproof Approval *1 *3 Applicable standard: FM3600, FM3615, FM3810, ANSI/NEMA250 Explosionproof for Class I, Division 1, Groups B, C and D Dust-ignitionproof for Class II/III, Division 1, Groups E, F and G Hazardous (classified) locations, indoors and outdoors (NEMA 4X) Division 2, 'SEALS NOT REQUIRED', Temp. Class: T6 Amb. Temp.: -40 to 60°C (-40 to 140°F)	<b>FF1</b>
	FM Intrinsically safe Approval *1 *3 Applicable standard: FM3600, FM3610, FM3611, FM3810, ANSI/NEMA250 Intrinsically Safe for Class I, Division 1, Groups A, B, C & D, Class II, Division 1, Groups E, F & G and Class III, Division 1 Hazardous Locations. Nonincendive for Class I, Division 2, Groups A, B, C & D, Class II, Division. 2, Groups E, F & G, and Class III, Division 1 Hazardous Locations. Enclosure: "NEMA 4X", Temp. Class: T4, Amb. Temp.: -40 to 60°C (-40 to 140°F) Intrinsically Safe Apparatus Parameters [Groups A, B, C, D, E, F and G] Vmax=30 V, Imax=165 mA, Pmax=0.9 W, Ci=22.5 nF, Li=730 μH [Groups C, D, E, F and G] Vmax=30 V, Imax=225 mA, Pmax=0.9 W, Ci=22.5 nF, Li=730 μH	<b>FS1</b>
	Combined FF1 and FS1 *1 *3	<b>FU1</b>
CENELEC ATEX	CENELEC ATEX (KEMA) Flameproof Approval *2 *3 Applicable standard: EN50014, EN50018, EN50281-1-1 Certificate: KEMA 02ATEX2148 II 2G EExd IIC T4, T5, T6 Amb. Temp.: T5; -40 to 80°C (-40 to 176°F), T4 and T6; -40 to 75°C (-40 to 167°F) Max. process Temp.: T4; 120°C (248°F), T5; 100°C (212°F), T6; 85°C (185°F)	<b>KF2</b>
	CENELEC ATEX (KEMA) Intrinsically safe Approval *2 *3 Applicable standard: EN50014, EN50020, EN500284, EN50281-1-1 Certificate: KEMA 02ATEX1030X II 1G EEx ia IIC T4, Amb. Temp.: -40 to 60°C (-40 to 140°F) Ui=30 V, Ii=165 mA, Pi=0.9 W, Ci=22.5 nF, Li=730 μH	<b>KS2</b>
	Combined KF2, KS2 and Type n *2 *3 Type n Applicable standard: EN50021 II 3G Ex nL IIC T4, Amb. Temp.: -40 to 60°C (-40 to 140°F) Ui=30 V DC, Ci=22.5 nF, Li=730 μH Dust II 1D maximum surface temperature T65°C (149°F) {Tamb.: 40°C (104°F)}, T85°C (185°F) {Tamb.: 60°C (140°F)}, T105°C (221°F) {Tamb.: 80°C (176°F)}	<b>KU2</b>

T10E.EPS

\*1: Applicable for Electrical connection code 2 and 7 (1/2 NPT female).

\*2: Applicable for Electrical connection code 2, 4, 7 and 9 (1/2 NPT and M20 female).

\*3: Applicable for Output signal code D and E. For intrinsically safe approval, use the safety barrier certified by the testing laboratories (BARD-400 is not applicable).

Item	Description	Code
Canadian Standards Association (CSA)	CSA Explosionproof Approval *1 *3 Applicable standard: C22.2 No. 0, No. 0.4, No. 25, No. 30, No. 94, No. 142 Certificate: 1089598 Explosionproof for Class I, Division 1, Groups B, C and D Dustignitionproof for Class II/III, Division 1, Groups E, F and G Division2 'SEALS NOT REQUIRED' , Temp. Class: T4, T5, T6 Encl Type 4x Max. Process Temp.: T4; 120°C (248°F), T5; 100°C (212°F), T6; 85°C (185°F) Amb. Temp.: -40 to 80°C (-40 to 176°F)	CF1
	CSA Intrinsically safe Approval *1 *3 Applicable standard: C22.2 No. 0, No. 0.4, No. 25, No. 30, No. 94, No. 142, No. 157, No. 213 Certificate: 1053843 Class I, Groups A, B, C and D Class II and III, Groups E, F and G Encl Type 4x, Temp. Class: T4, Amb. Temp.: -40 to 60°C (-40 to 140°F) Vmax=30 V, Imax=165 mA, Pmax=0.9 W, Ci=22.5 nF, Li=730 μH	CS1
	Combined CF1 and CS1 *1 *3	CU1
IECEX Scheme *4	IECEX Intrinsically safe, type n and Flameproof Approval *3 *9 Intrinsically safe and type n Applicable Standard: IEC 60079-0:2004, IEC 60079-11:1999, IEC 60079-15:2005, IEC 60079-26:2005 Certificate: IECEX KEM 06.0007X Ex ia IIC T4, Ex nL IIC T4 Enclosure: IP67 Amb. Temp.: -40 to 60°C (-40 to 140°F), Max. Process Temp.: 120°C (248°F) Electrical Parameters: [Ex ia] Ui=30 V, Ii=165 mA, Pi=0.9 W, Ci=22.5 nF, Li=730 μH [Ex nL] Ui=30 V, Ci=22.5 nF, Li=730 μH  Flameproof Applicable Standard: IEC 60079-0:2004, IEC60079-1:2003 Certificate: IECEX KEM 06.0005 Ex d IIC T6...T4 Enclosure: IP67 Max.Process Temp.: T4:120°C (248°F), T5;100°C (212°F), T6; 85°C (185°F) Amb.Temp.: -40 to 75°C (-40 to 167°F) for T4, -40 to 80°C (-40 to 176°F) for T5, -40 to 75°C (-40 to 167°F) for T6	SU2
TIIS certification	TIIS Flameproof Approval, Ex do IIC T4X *3 *5 *7 *8 Certificate: C15296 (Without integral indicator) C15297 (With integral indicator) Amb. Temp.: -20 to 60°C, Process Temp.: -20 to 120°C	FS3
	TIIS Intrinsically safe Approval, Ex ia IIC T4 *6 *8 Certificate: C14632 Amb. Temp.: -20 to 60°C, Process Temp.: -20 to 120°C	JS3
Attached flameproof packing adapter *5	Electrical connection: G1/2 female Applicable cable: O. D. 8 to 12 mm	1 pc.
		2 pcs.
		G11
		G12

T11E.EPS

- \*1: Applicable for Electrical connection code 2 and 7 (1/2 NPT female).
- \*2: Applicable for Electrical connection code 2, 4, 7 and 9 (1/2 NPT and M20 female).
- \*3: Applicable for Output signal code D and E. For intrinsically safe approval, use the safety barrier certified by the testing laboratories (BARD-400 is not applicable).
- \*4: Applicable only for Australia and New Zealand area.
- \*5: If cable wiring is to be used to a TIIS flameproof type transmitter, add the YOKOGAWA-assured flameproof packing adapter.
- \*6: Applicable for Output signal code D. See <Safety Barrier for TIIS Intrinsically Safe Type>.
- \*7: In case that the ambient temperature exceeds 50°C or that the ambient temperature exceeds 45°C with the process temperature of 90°C or above, use heat-resistant cables with maximum allowable temperature of 75°C or above.
- \*8: TIIS (The Technology Institution of Industrial Safety) Certification is a new notation for the explosionproof approval in Japan instead of JIS.
- \*9: Applicable for Electrical connection code 2, 4 and 7 (1/2 NPT and M20 female).

**OPTIONAL SPECIFICATIONS**

Item		Description	Code
Painting *10	Color change	Amplifier cover only	P□
		Amplifier cover and terminal cover, Munsell 7.5 R4/14	PR
	Coating change	Epoxy resin-baked coating *12	X1
Lightning protector	Transmitter power supply voltage : 10.5 to 32 V DC (10.5 to 28 V DC for TIIS intrinsically safe type, 10.5 to 30 V DC for intrinsically safe type other than TIIS, or 9 to 32 V DC for Fieldbus communication type.) Allowable current : Max. 6000 A (1×40 μs), Repeating 1000 A (1×40 μs) 100 times		A
Oil-prohibited use	Degrease cleansing treatment		K1
	Degrease cleansing treatment and with fluorinated oil filled capsule. Operating temperature -20 to 80°C		K2
Oil-prohibited use with dehydrating treatment	Degrease cleansing treatment and dehydrating treatment		K5
	Degrease cleansing treatment and dehydrating treatment with fluorinated oilfilled capsule. Operating temperature -20 to 80°C		K6
Calibration units *1	P calibration (psi unit)	( See Table 1. on page 9 )	D1
	bar calibration (bar unit)		D3
	M calibration (kgf/cm <sup>2</sup> unit)		D4
Sealing treatment to JIS SUS630 nuts	Sealant(liquid silicone rubber) is coated on JIS SUS630 cover flange mounting nuts against stress corrosion cracking.		Y
Long vent *2	Total length: 119 mm (standard: 34 mm); Total length when combining with Optional code K1, K2, K5, and K6: 130 mm. Material: SUS316.		U
Fast response *8	Update time: 0.125 sec or less Amplifier assembly damping time constant: 0.1 to 64 sec in 9 increments. Response time (with min. damping time constant): max. 0.5 sec (for L capsule: max. 0.6 sec)		F1
Failure alarm down-scale *3	Output status at CPU failure and hardware error is -5%, 3.2 mA or less.		C1
NAMUR NE43 compliant *3 *9	Output signal limits: 3.8 mA to 20.5 mA	Failure alarm down-scale: output status at CPU failure and hardware error is -5%, 3.2 mA or less.	C2
		Failure alarm up-scale: output status at CPU failure and hardware error is 110%, 21.6 mA or more.	C3
Stainless steel amplifier housing *4	Amplifier housing material : JIS SCS14A stainless steel (equivalent to JIS SUS316 cast stainless steel or ASTM CF-8M)		E1
Gold-plate	Surface of isolating diaphragms are gold plated, effective for hydrogen permeation.		A1
Stainless steel tag plate	304SST tag plate wired onto transmitter		N4
Mill Certificate	Cover flange, Process connector, Manifold, orifice, spacer		M12
Pressure test/Leak test Certificate *11	Test Pressure : 3.5 MPa{ 35 kgf/cm <sup>2</sup> } *5	Nitrogen (N <sub>2</sub> ) Gas *7 Retention time: 10 minutes	T01
	Test Pressure : 14 MPa{ 140 kgf/cm <sup>2</sup> } *6		T02


T08E.EPS

- \*1: The unit of MWP (Max. working pressure) on the name plate of a housing is the same unit as specified by Option code D1, D3, and D4.
- \*2: Applicable for vertical impulse piping type (Installation code 2, 3, 6, or 7).
- \*3: Applicable for Output signal code D and E. The hardware error indicates faulty amplifier or capsule. When combining with Option code F1, output status for down-scale is -2.5%, 3.6 mA DC or less.
- \*4: Applicable for Electrical connection code 2, 3, 4, and 7. Not applicable for Option code P□ and X1.
- \*5: Applicable for Capsule code L.
- \*6: Applicable for Capsule code M and H.
- \*7: Pure nitrogen gas is used for oil-prohibited use (Option code K1, K2, K5, and K6).
- \*8: Applicable for Output signal code D and E.
- \*9: Not applicable for Option code C1.
- \*10: Standard polyurethan painting can be used in acid atmosphere, whereas the epoxy resin-baked coating (Option code X1) can be used in alkaline atmosphere. Anti-corrosion coating, the combination of polyurethan and epoxy resin-baked coating, is available by special order as sea water, alkaline, and acid resistant.
- \*11: The unit on the certificate is always MPa regardless of selection of option code D1, D3, or D4.
- \*12: Not applicable for color change option.


## DIMENSIONS

### Vertical Impulse Piping Type


#### Manifold upside (INSTALLATION CODE '6')

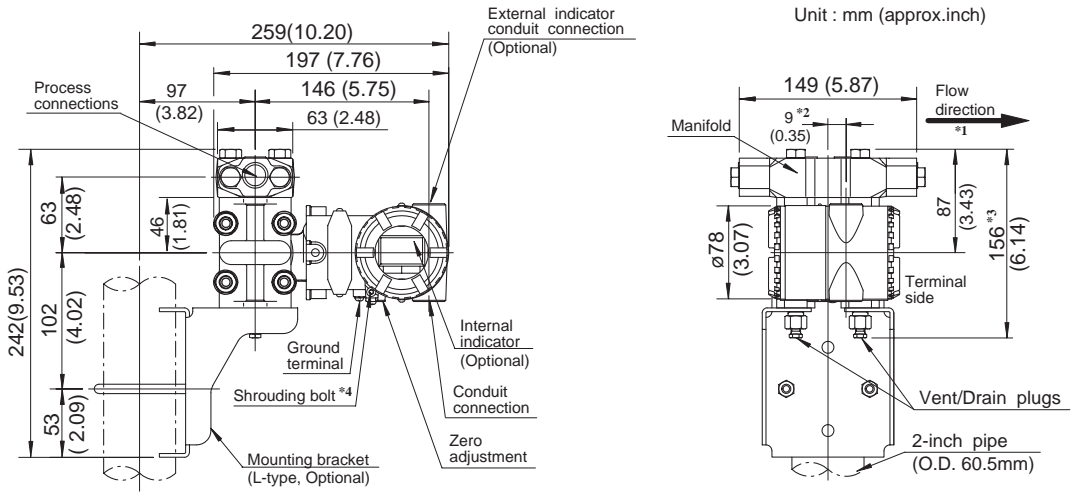

#### Manifold downside (INSTALLATION CODE '7')

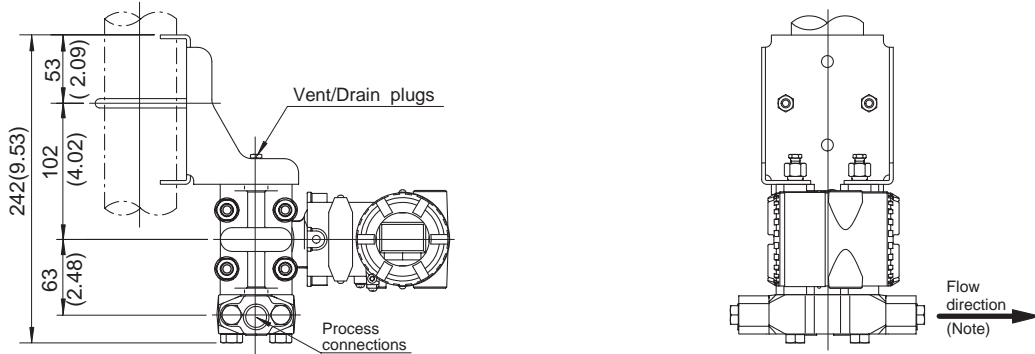


### Horizontal Impulse Piping Type (INSTALLATION CODE '9')

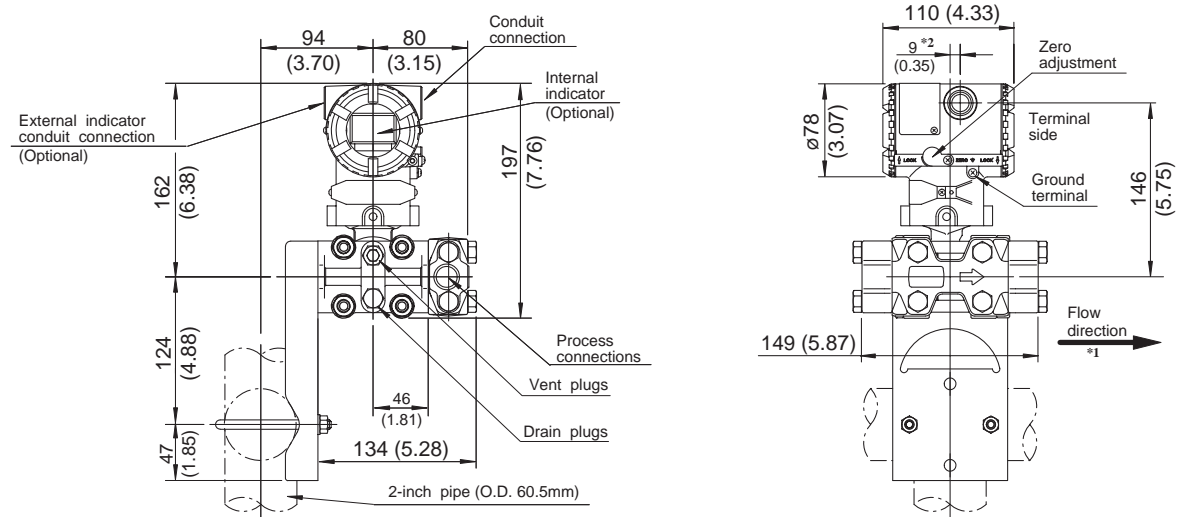

F03E.EPS

- \*1: When Installation code 2, 3, or 8 is selected, flow direction arrow mark on above figure are reversed. (i.e. Flow direction is on the left side.)
- \*2: 15mm (0.59 inch) for right side high pressure (Installation code 2, 3, or 8).
- \*3: When Optional code K1, K2, K5, or K6 is selected, add 15 mm(0.59 inch) to the value in the figure.
- \*4: Applicable only for ATEX, IECEx, and TIIS Flameproof type.

● Terminal Configuration

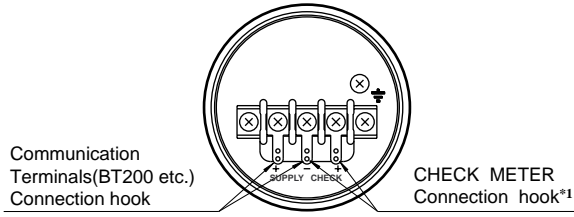

● Terminal Wiring

SUPPLY + -	Power supply and output terminal
CHECK + -	External indicator(ammeter) terminal*1
⏏	Ground terminal

\*1: When using an external indicator or a check meter, the internal resistance must be 10 Ω or less. Not available for Fieldbus communication(Output signal code F).

F05E.EPS

Table 1. Calibration Units

Measurement Span and Range		Optional Code		
		D1 ( psi Unit )	D3 ( bar Unit )	D4 ( kgf/cm <sup>2</sup> Unit )
L	Span	2 to 40 inH <sub>2</sub> O	5 to 100 mbar	50 to 1000 mmH <sub>2</sub> O
	Range	0 to 40 inH <sub>2</sub> O	0 to 100 mbar	0 to 1000 mmH <sub>2</sub> O
M	Span	8 to 400 inH <sub>2</sub> O	20 to 1000 mbar	200 to 10000 mmH <sub>2</sub> O
	Range	0 to 400 inH <sub>2</sub> O	0 to 1000 mbar	0 to 10000 mmH <sub>2</sub> O
H	Span	80 to 840 inH <sub>2</sub> O	200 to 2100 mbar	2000 to 21000 mmH <sub>2</sub> O
	Range	0 to 840 inH <sub>2</sub> O	0 to 2100 mbar	0 to 21000 mmH <sub>2</sub> O

T09E.EPS

< Ordering Information > “◇”

Specify the following when ordering

1. Model, suffix codes, and optional codes
2. Calibration range and units:
  - 1) Calibration range can be specified with range value specifications up to 5 digits (excluding any decimal point) for low or high range limits within the range of -32000 to 32000.
  - 2) Specify only one unit from the table, ‘Settings when shipped.’
3. Select linear or square root for output mode and display mode.
 

Note: If not specified, the instrument is shipped set for linear mode.
4. Select normal or reverse for operation mode
 

Note: If not specified, the instrument is shipped in normal operation mode.
5. Display scale and units (for transmitters equipped with integral indicator only)
 

Specify either 0 to 100 % or engineering unit scale and ‘Range and Unit’ for engineering units scale:  
Scale range can be specified with range limit specifications up to 5 digits (excluding any decimal point) for low or high range limits within the range of -19999 to 19999.
6. Tag Number (if required)
7. Necessary data for orifice calculations (integral orifice flow specifications), or required values for orifice bore and differential pressure range. Refer to TI 01C20K00-01E for details.

< Related Instruments > “◇”

Power Distributor: Refer to GS 01B04T01-02E or GS 01B04T02-02E  
BRAIN TERMINAL: Refer to GS 01C00A11-00E

< Safety Barrier for TIIS Intrinsically Safe Type >

Supplier	Type	Model
MTL	Isolator	MTL3046B
		MTL4041B
P+F		KFD2-STC3-Ex 1
		KFD2-STV3-Ex 1-1, 2, 3

T001E.EPS

Note: Requirements of capacitance and inductance for cable wiring.

$$C_w \leq C_o - 11[\text{nF}]$$

$$L_w \leq L_o - 730[\mu\text{H}]$$

(C<sub>o</sub>: Max. external capacitance)  
(L<sub>o</sub>: Max. external inductance)

< Reference >

1. JIS SUS316L stainless steel; Equivalent to AISI 316L.
2. JIS SUS316 stainless steel; Equivalent to AISI 316.
3. JIS SUS304 stainless steel; Equivalent to AISI 304.
4. JIS S25C carbon steel; Equivalent to AISI 1025.
5. JIS SECC Carbon steel.
6. Teflon; Trademark of E.I. DuPont de Nemours & Co.
7. JIS SCM435 chrome molybdenum steel; Equivalent to AISI 4137.
8. JIS SUS630 stainless steel; Equivalent to ASTM 630.
9. Hastelloy; Trademark of Haynes International Inc.
10. JIS SCS14A stainless steel; Equivalent to JIS SUS316 cast stainless steel or ASTM CF-8M.
11. HART; Trademark of the HART Communication Foundation.
12. FOUNDATION; Trademark of Fieldbus Foundation.
13. Other company names and product names used in this material are registered trademarks or trademarks of their respective owners.